


Connection Diagram of ASTI pH/ORP Sensors WITHOUT Preamplifiers To Rosemount 1066 pH/ORP Transmitters

pH / ORP SENSOR WIRING -1066 (Refer to manual for recommended order)

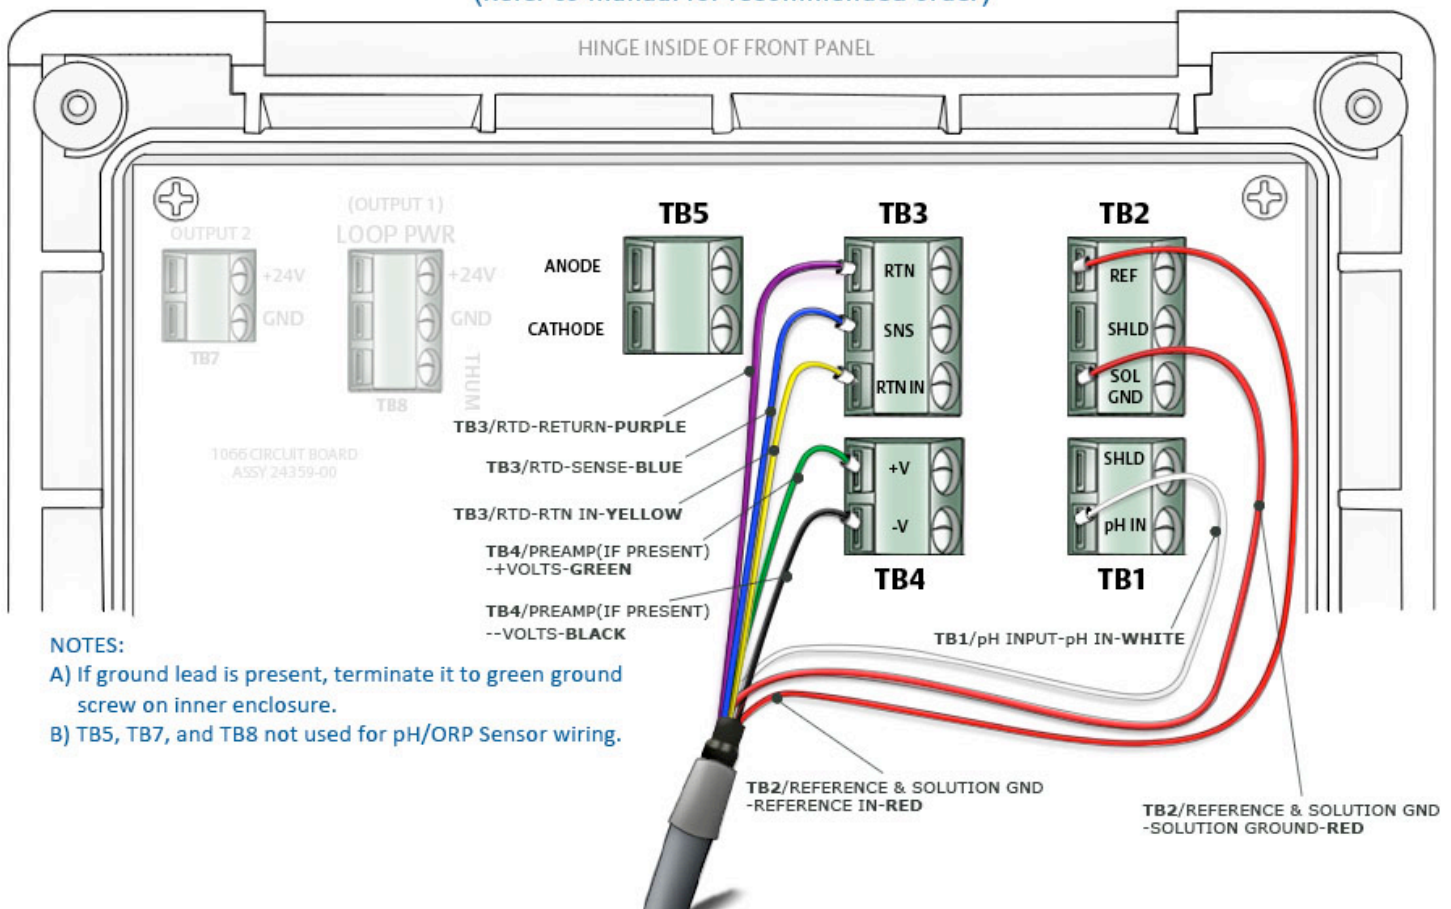

NOTES:

- A) If ground lead is present, terminate it to green ground screw on inner enclosure.
- B) TB5, TB7, and TB8 not used for pH/ORP Sensor wiring.

Note 1: Temperature element (RTD) is Platinum 1000 Ohm type unless otherwise specified.

Note 2: Sensor diagnostics are not supported. All diagnostics should be disabled to avoid errors being reported on the transmitter.